
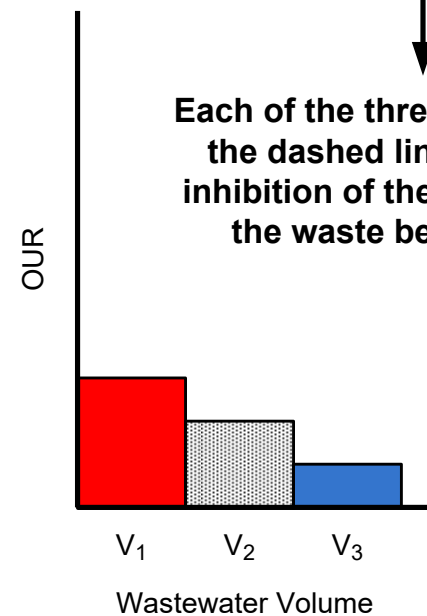
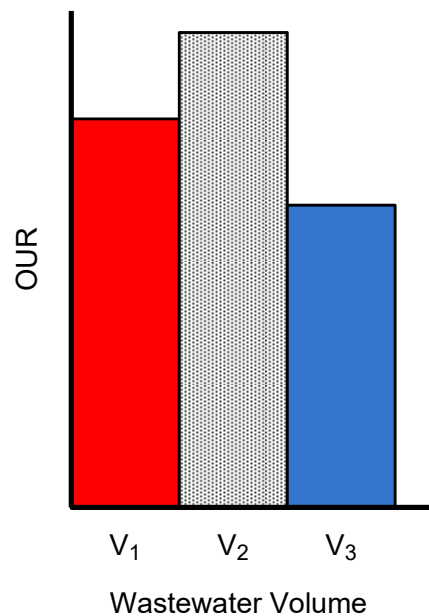


Note:

The total volume in each bottle is 300 mL (BOD₅ bottle).
The wastewater or sample volumes (V_1 , V_2 , and V_3)
added to the BOD₅ bottles might be 0.3 mL (1,000 ppm),
0.5 mL (1,667 ppm), and 0.7 mL (2,333 ppm).

The two graphs above the dashed line
indicate no inhibition of the biomass from
the waste being treated.

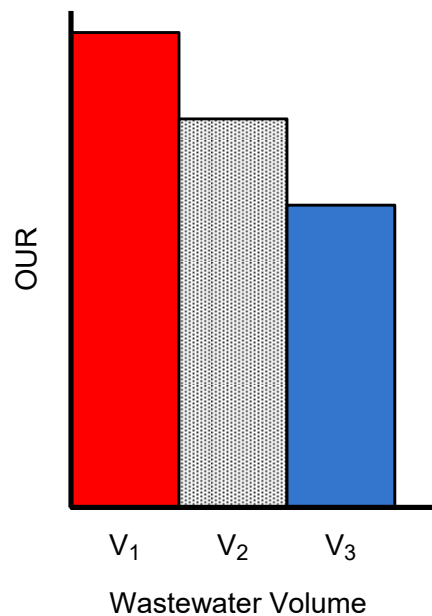

Each of the three graphs below
the dashed line do indicate
inhibition of the biomass from
the waste being treated.